(Attachment 1)

TREATMENT LICENSE GRADE REQUIRED

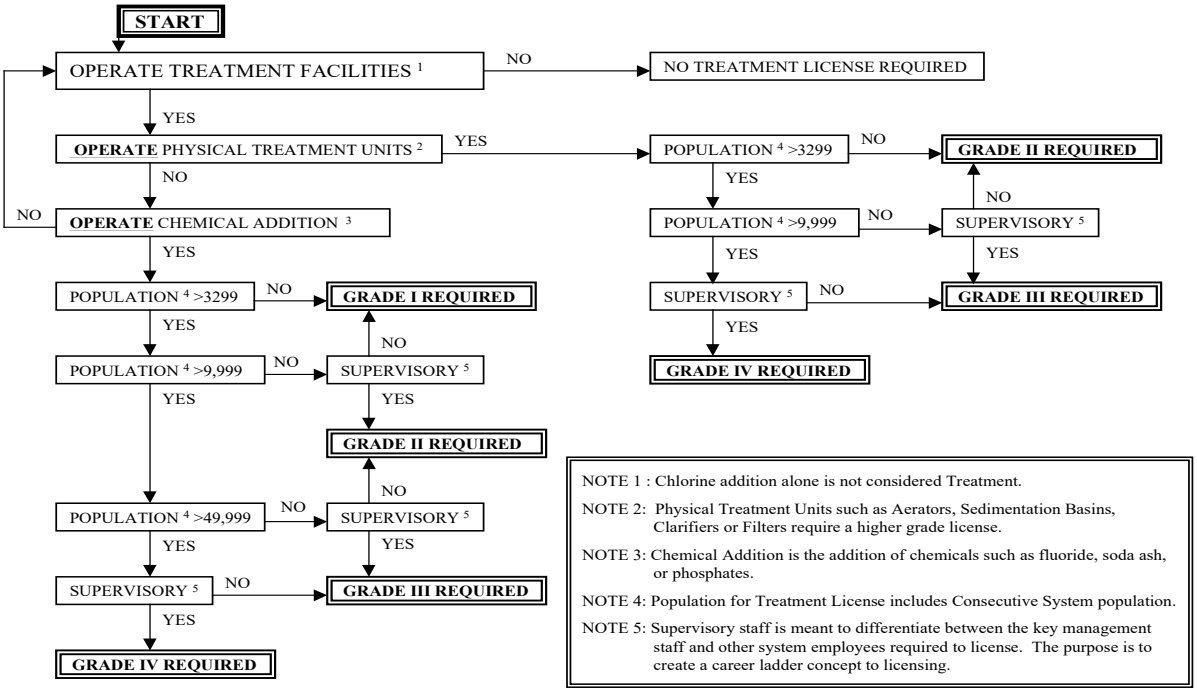

NOTE 1 : Chlorine addition alone is not considered Treatment.

NOTE 2: Physical Treatment Units such as Aerators, Sedimentation Basins, Clarifiers or Filters require a higher grade license.

NOTE 3: Chemical Addition is the addition of chemicals such as fluoride, soda ash, or phosphates.

NOTE 4: Population for Treatment License includes Consecutive System population.

NOTE 5: Supervisory staff is meant to differentiate between the key management staff and other system employees required to license. The purpose is to create a career ladder concept to licensing.

DISTRIBUTION LICENSE GRADE REQUIRED

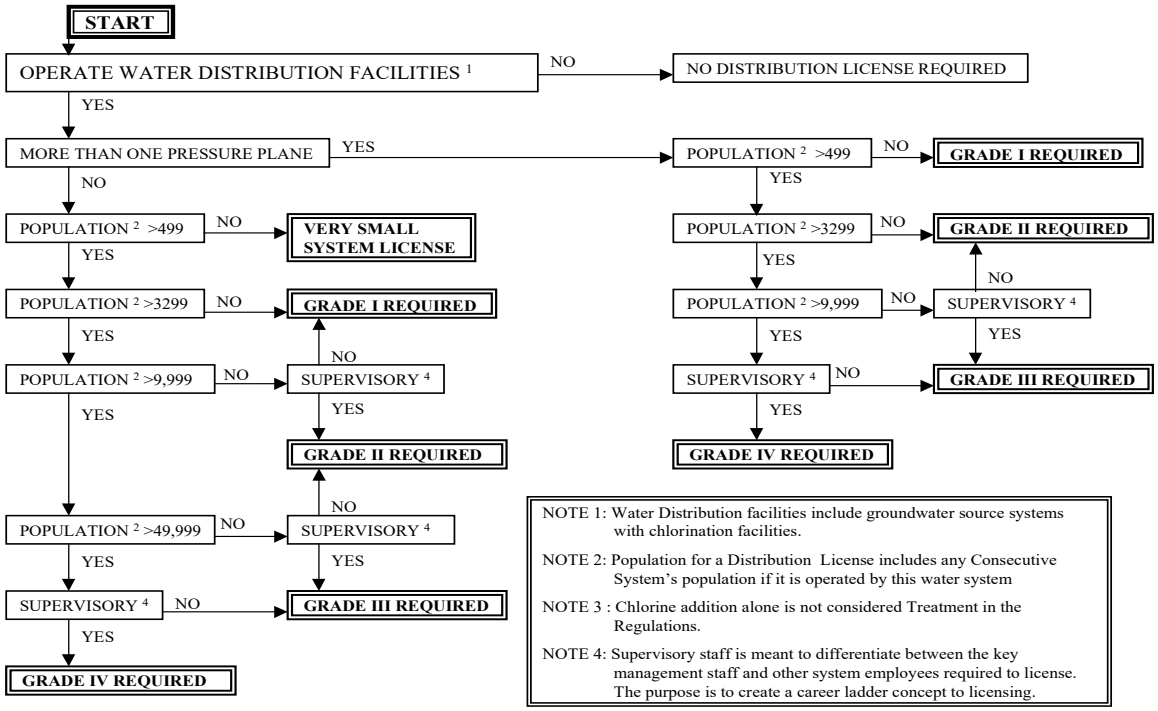

NOTE 1: Water Distribution facilities include groundwater source systems with chlorination facilities.

NOTE 2: Population for a Distribution License includes any Consecutive System's population if it is operated by this water system

NOTE 3 : Chlorine addition alone is not considered Treatment in the Regulations.

NOTE 4: Supervisory staff is meant to differentiate between the key management staff and other system employees required to license. The purpose is to create a career ladder concept to licensing.